


PLAN VIEW

N.T.S.

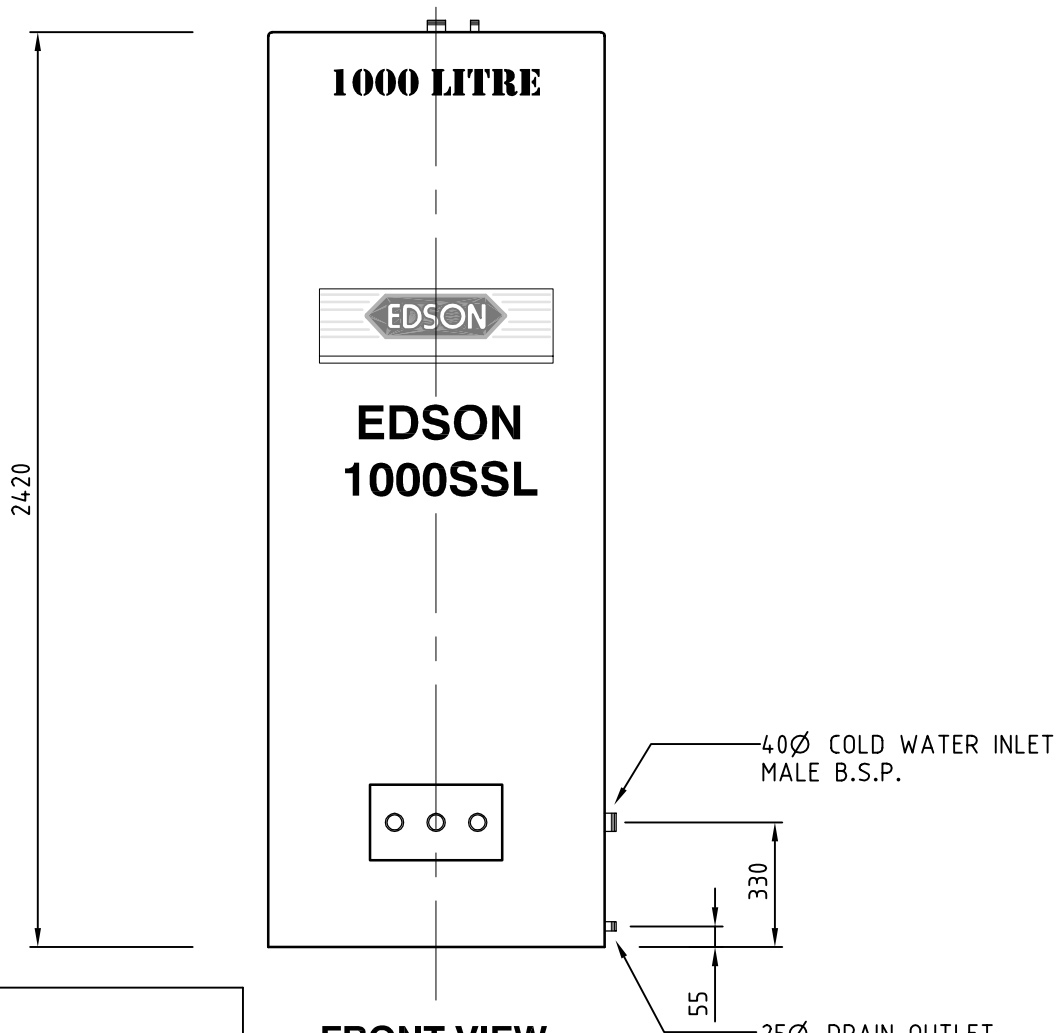

FRONT VIEW

N.T.S.

GENERAL NOTES:

- NOTE 1. A MINIMUM OF 800mm SHOULD BE LEFT IN FRONT OF THE WATER HEATER FOR ACCESS & SERVICING.
- NOTE 2. A MINIMUM SPACE BETWEEN WALL AND BACK OF WATER HEATER IS 100mm.
- NOTE 3. 3 x 4.8 kW ELEMENTS.
- NOTE 4. OTHER OPTIONS AVAILABLE ON REQUEST.
- NOTE 5. TOLERANCE OF (+) OR (-) 10mm.

LONG LIFE ELECTRIC HOT WATER HEATER - 1000SSL